



MORIN BUILDING
8570 EXECUTIVE PARK AVENUE
FAIRFAX, VIRGINIA 22116-0815

June 30, 2020

To: All Prospective Bidders
Issued by: Torry Huff, CPPB, VCO, VCCO, Senior Procurement Specialist
Subject: Addendum # 1 to IFB #20-033, Newington Fire Alarm System Replacement

The purpose of this addendum is to make revisions to the IFB and to answer questions submitted by the specified deadline for their submission.

I. Additions, Deletions, Corrections, and Revisions to the IFB

1. Contract Drawing Sheet FA1. Delete in its entirety and replace with attached Contract Drawing Sheet FA1.

II. Attachments

1. Contract Drawing Sheet FA1
2. Pre-Bid Meeting Attendee List

III. Acknowledgement

Acknowledge your receipt of, and compliance with, this Addendum by either signing the attached acknowledgement, or referencing its receipt and your compliance, in your bid.

END OF ADDENDUM NO. 1

ACKNOWLEDGEMENT OF RECEIPT OF ADDENDUM # 1

I certify that the information contained in the proposal submitted on behalf of the below named firm incorporates any and all changes to the original specification. I further certify by my signature below, that I am fully authorized to acknowledge receipt of the above addendum and also bind the below named firm to the terms, conditions and specifications of the RFP and any changes thereto made by this addendum.

ACKNOWLEDGED BY:


FOR: _____
Company Name

Date

Signature of Authorized Agent

Printed/typed name

Title


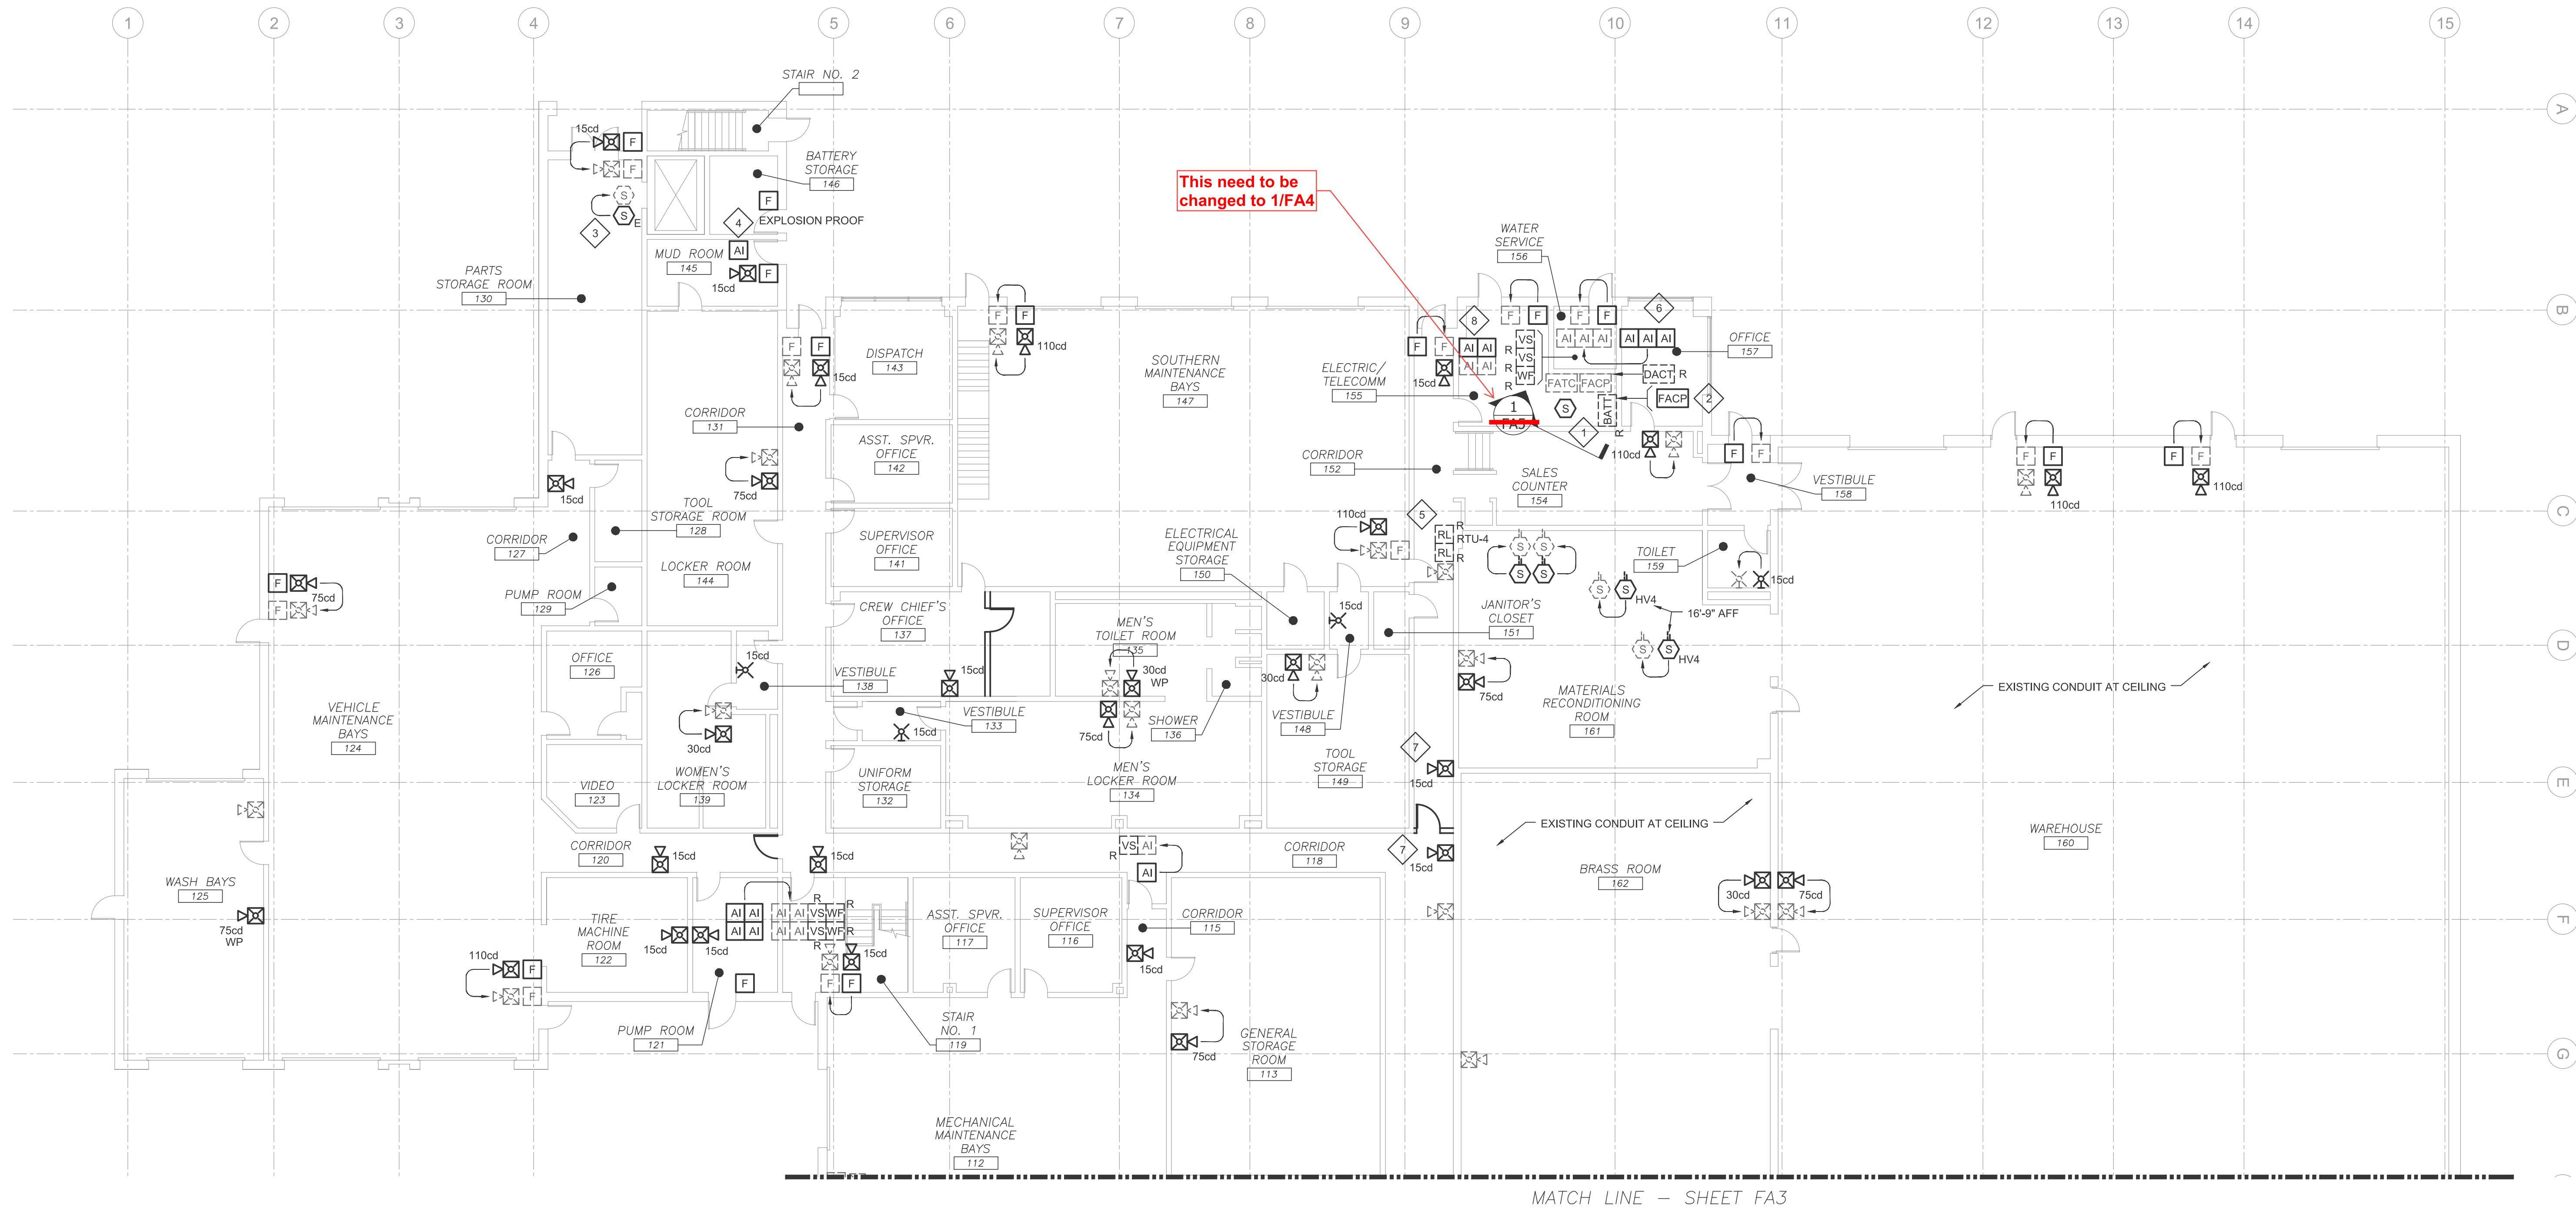


1 FIRST FLOOR NEW WORK FIRE ALARM PLAN - PART A
 FA2 3/32"=1'-0"

KEY NOTES

1. EXISTING DACT TO REMAIN.
2. PROVIDE NEW FIRE ALARM CONTROL PANEL, TO BE LOCATED ABOVE EXISTING BATTERY CABINET.
3. LOCATE SMOKE DETECTOR NO MORE THAN 12" FROM CEILING.
4. PROVIDE ADDRESSABLE INTERFACE TO MONITOR MANUAL PULL STATION INSIDE THE BATTERY ROOM.
5. EXISTING REMOTE LED FOR DUCT SMOKE DETECTOR TO REMAIN.
6. PROVIDE NEW ADDRESSABLE INTERFACES TO CONNECT WATER FLOW AND TAMPER SWITCHES TO THE NEW FACP AT THE BEGINNING OF THE RENOVATION, TO BE ACTIVE DURING THE ENTIRE RENOVATION.
7. PROVIDE TEMPORARY HORN/STROBES IN MAIN CORRIDOR TO BE IN SERVICE DURING ENTIRE FIRE ALARM RENOVATION.
8. PROVIDE ADDRESSABLE INTERFACES TO MONITOR GENERATOR RUN AND FAULT

KEY PLAN

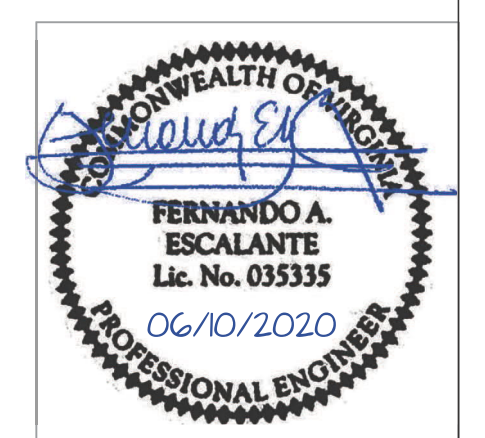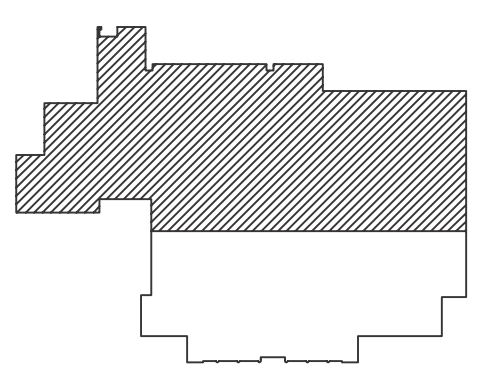

FAIRFAX WATER PLANNING & ENGINEERING DIVISION	DESIGNED: PAM DRAWN: PAM CHECKED: FAE	NO. DATE REVISION	SCALE 3/32"=1'-0"	FAIRFAX WATER PLANNING & ENGINEERING DIVISION 8560 ARLINGTON BOULEVARD FAIRFAX, VA 22031		Newington Maintenance Facility NEWINGTON FIRE ALARM SYSTEM REPLACEMENT FIRST FLOOR NEW WORK PLAN - PART A	FILE NAME: _____ PROJECT: 0650 DIVISION: 002 DATE: 5-Jun-20 TAX MAP: 99-2 DRAWING: FA1 SHEET: 3 of 7

IFB 20-033 Newington Fire Alarm System Replacement

Project 0650 Division 002

Pre-Bid Attendee List - Monday, June 22nd

Company Name

MC Dean

Redhawk Fire and Security

Contact Name

Troy Messick

Phil Kirchberg

Email Address

troy.messick@mcdean.com

philipkirchberg@adt.com

Telephone Number

703-929-8937

240-372-2072